


PRESSURE FILTER

Series ML 30, MLO 30 DN 6 PN 160

Sheet No.
1417 F

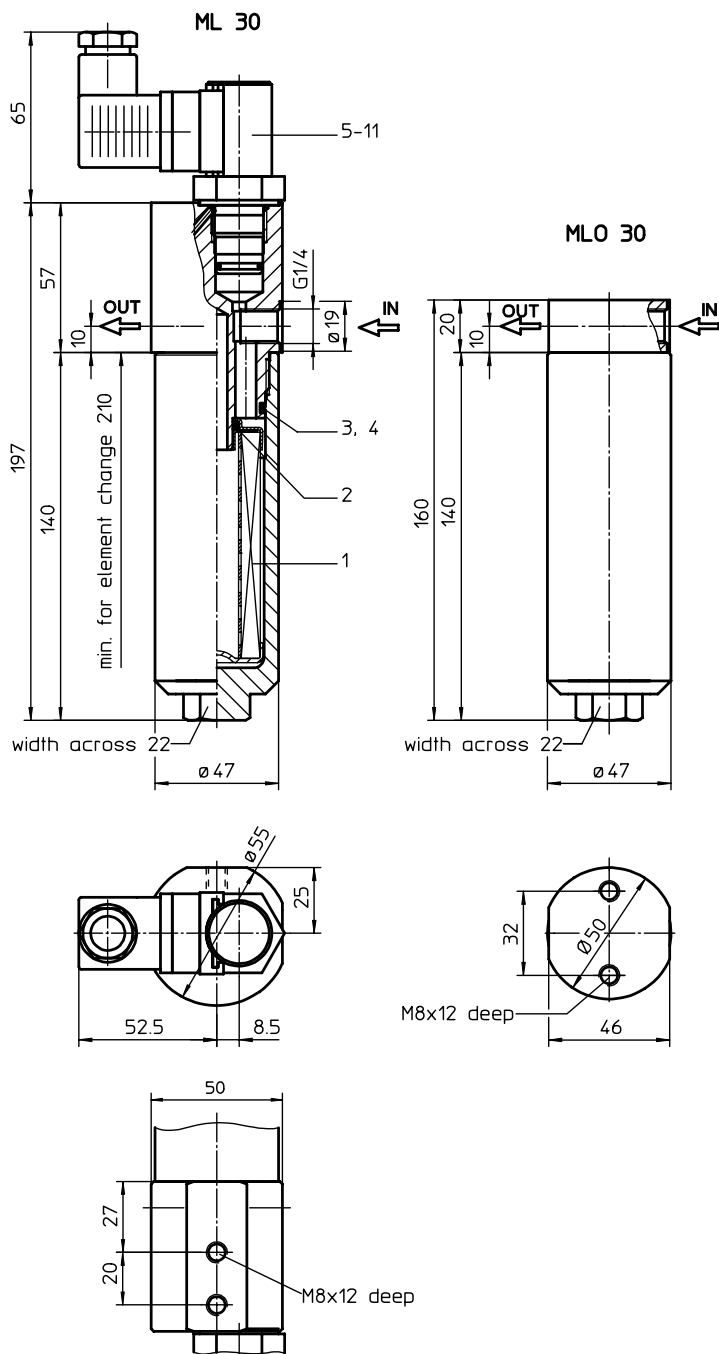

1. Type index:

1.1. Complete filter: (ordering example)

ML. 30. 10VG. HR. E. P. - . G. 1. - . AE

1	2	3	4	5	6	7	8	9	10	11
---	---	---	---	---	---	---	---	---	----	----

- 1 series:
 - ML = in-line filter-medium pressure range with indicator
 - MLO = in-line filter-medium pressure range without indicator
- 2 nominal size: 30
- 3 filter-material and filter-fineness:
 - 80 G = 80 μm , 40 G = 40 μm , 25 G = 25 μm stainless steel wire mesh
 - 25 VG= 20 $\mu\text{m}_{(c)}$, 16 VG= 15 $\mu\text{m}_{(c)}$, 10 VG= 10 $\mu\text{m}_{(c)}$, 6 VG = 7 $\mu\text{m}_{(c)}$, 3 VG = 5 $\mu\text{m}_{(c)}$ Interpor fleece (glass fibre)
- 4 resistance of pressure difference for filter element:
 - 30 = Δp 30 bar
 - HR = Δp 160 bar (rupture strenght Δp 250 bar)
- 5 filter element design:
 - E = single-end open
- 6 sealing material:
 - P = Nitrile (NBR)
 - V = Viton (FPM)
- 7 filter element specification: (see catalog)
 - = standard
 - VA = stainless steel
 - IS06 = see sheet-no. 31601
- 8 connection:
 - G = thread connection according to ISO 228
- 9 connection size:
 - 1 = G $\frac{1}{4}$
- 10 filter housing specification: (see catalog)
 - = standard
 - IS06 = see sheet-no. 31605
- 11 clogging indicator or clogging sensor:
 - series MLO:
 - = without
 - series ML:
 - AOR = visual, see sheet-no. 1606
 - AOC = visual, see sheet-no. 1606
 - AE = visual-electrical, see sheet-no. 1615
 - VS1 = electrical, see sheet-no. 1617
 - VS2 = electrical, see sheet-no. 1618

1.2. Filter element: (ordering example)

01E. 30. 10VG. HR. E. P. -

1	2	3	4	5	6	7
---	---	---	---	---	---	---

- 1 series:
 - 01E. = filter element according to INTERNORMEN factory specification
- 2 nominal size: 30
- 3 - 7 see type index-complete filter

weight without indicator: approx. 1,1 kg
weight with indicator : approx. 1,3 kg

Changes of measures and design are subject to alteration!

EDV 09/09

internormen
technology

Friedensstrasse 41, 68804 Altlusheim, Germany

phone +49 - (0)6205 - 2094-0
fax +49 - (0)6205 - 2094-40

e-mail sales@internormen.com
url www.internormen.com



2. Spare parts:

item	qty.	designation	dimensions	article-no.	
1	1	filter element	01E.30		
2	1	O-ring	11 x 3	312603 (NBR)	312727 (FPM)
3	1	O-ring	32 x 2,5	306843 (NBR)	308268 (FPM)
4	1	support ring	37 x 2,1 x 1	305466	
5	1	clogging indicator, visual	AOR or AOC	see sheet-no. 1606	
6	1	clogging indicator, visual-electrical	AE	see sheet-no. 1615	
7	1	clogging sensor, electrical	VS1	see sheet-no. 1617	
8	1	clogging sensor, electrical	VS2	see sheet-no. 1618	
9	1	O-ring	15 x 1,5	315357 (NBR)	315427 (FPM)
10	1	O-ring	22 x 2	304708 (NBR)	304721 (FPM)
11	1	O-ring	14 x 2	304342 (NBR)	304722 (FPM)

3. Description:

Pressure filter of the series ML 30 and MLO 30 are suitable for a working pressure up to 160 bar.

The pressure peaks are absorbed by a sufficient margin of safety. The filter is in-line mounted.

The filter element consists of star-shaped, pleated filter material which is supported on the inside by a perforated core tube and is bonded to the end caps with a high-quality adhesive. The flow direction is from outside to inside.

Filter elements are available down to 4 $\mu\text{m}_{(e)}$.

INTERNORMEN-Filter elements are known as elements with a high intrinsic stability and an excellent filtration capability, a high dirt-retaining capacity and a long service life.

INTERNORMEN-Filter are suitable for all petroleum based fluids, HW-emulsions, most synthetic hydraulic fluids and lubrication oils.

INTERNORMEN-Filter elements are available up to a pressure difference resistance of Δp 160 bar and a rupture strength of Δp 250 bar.


4. Technical data:

temperature range:	-10°C to + 80°C (for a short time + 100°C)
operating medium:	mineral oil, other media on request
max. operating pressure:	160 bar
test pressure:	229 bar
connection system:	thread connection according to ISO 228
housing material:	Al; C-steel
sealing material:	Nitrile (NBR) or Viton (FPM), other materials on request
installation position:	vertical
volume tank:	0,1 l

Classified under the Pressure Equipment Directive 97/23/EC for mineral oil (fluid group 2), Article 3, Para. 3.

Classified under ATEX Directive 94/9/EC according to specific application (see questionnaire sheet-no. 34279-4).

5. Symbols:

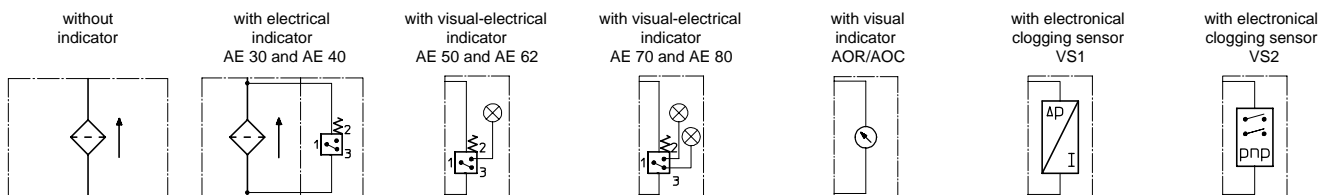

6. Pressure drop flow curves:

Precise flow rates see INT-Expert-System Filter respectively Δp -curves - depending on filter fineness and viscosity.

7. Test methods:

Filter elements are tested according to the following ISO standards:

- ISO 2941 Verification of collapse/burst resistance
- ISO 2942 Verification of fabrication integrity
- ISO 2943 Verification of material compatibility with fluids
- ISO 3723 Method for end load test
- ISO 3724 Verification of flow fatigue characteristics
- ISO 3968 Evaluation of pressure drop versus flow characteristics
- ISO 16889 Multi-pass method for evaluating filtration performance